

HZFA-V

W

A

Ö

”

┐

”

’

HZFA-V




—



NP

AC220V ± 20

15A



CT/PT

3


PT

CT

PT

/

赫兹电力
HERTZ POWER

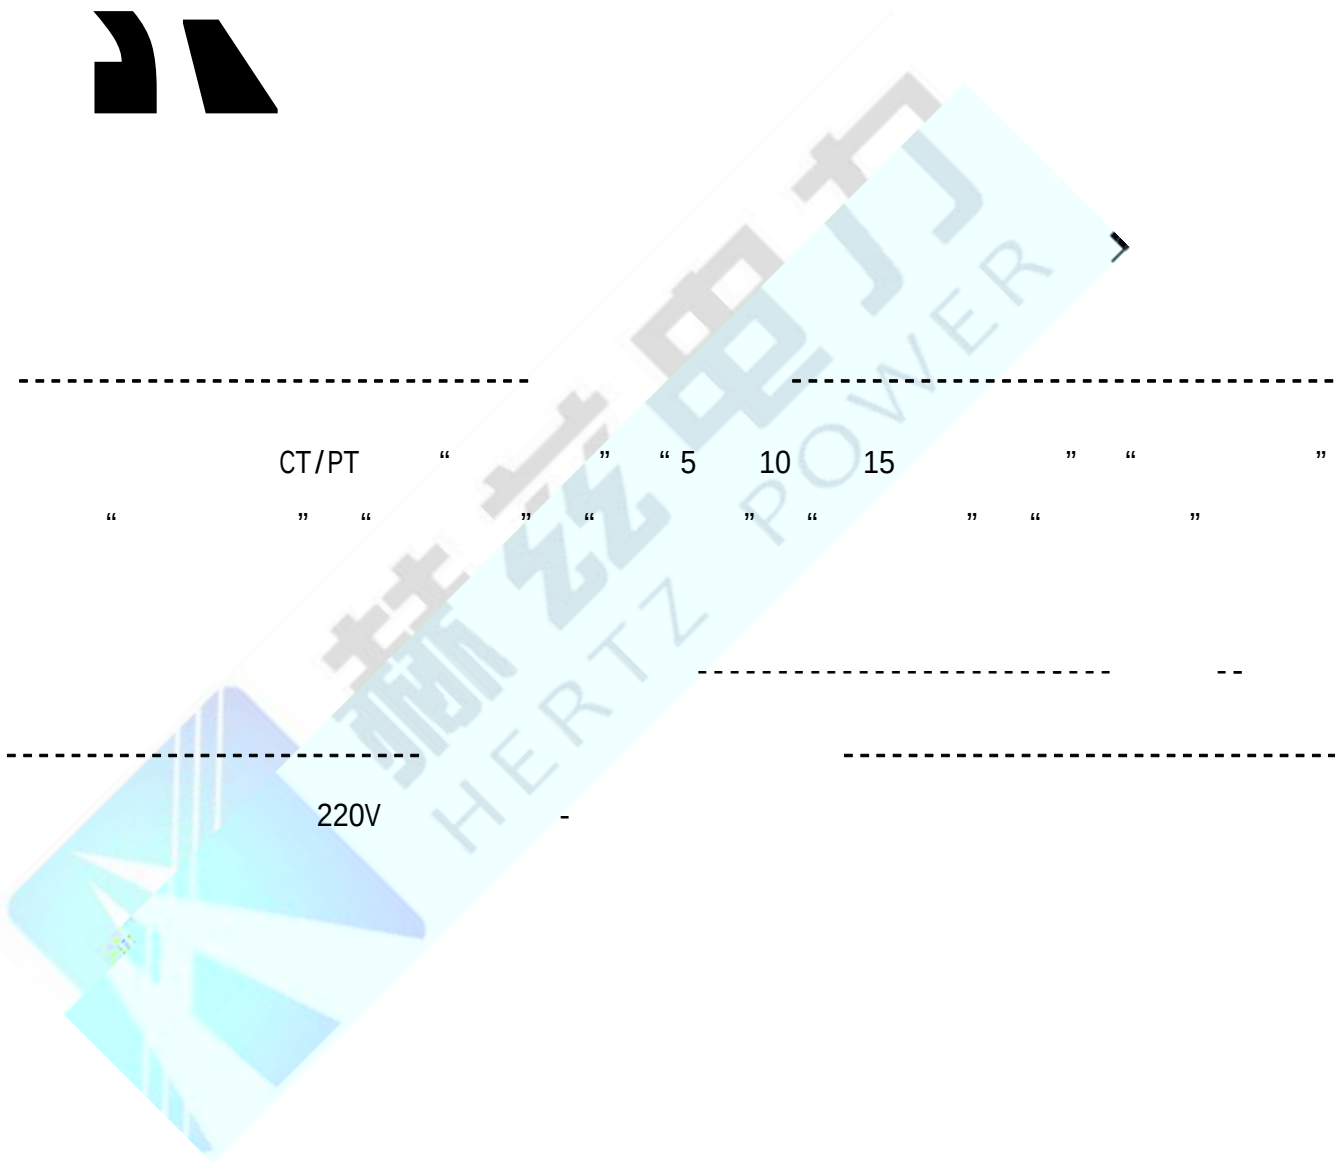

2000

/

RS232

U

20Kg

CT	220V	0—1000V	3KVA	< 0.5%
PT	220V	0—330V	3KVA	< 0.5%
CT	220V	0-8V		< 0.5%
PT	220V	0—1000V		< 0.5%
CT				



220V

CT PT U

全功能互感器综合测试仪

CT 测试

PT 测试

数据查询

U盘转存

系统设置

08-12-28 15:30

CT

CT

CT

A.

CT 参数设置

编号: ABC001

相序: A

Kn: 1



变比: 1000:5

确定

:

CT




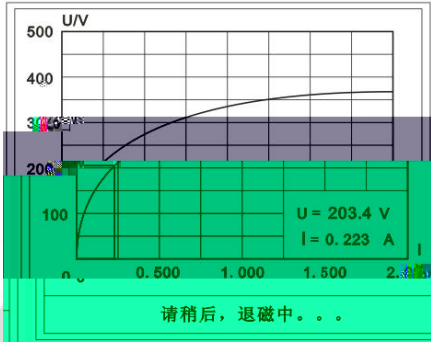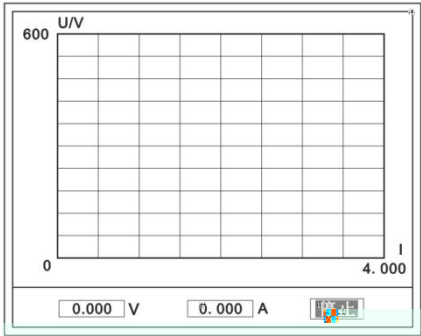

d.



()

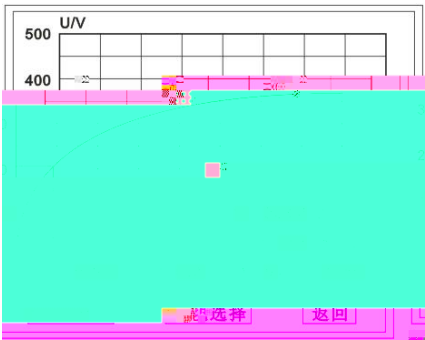





CT

b.

CT

L1 L2

CT

K1 K2



c.




CT



e.

5

200A

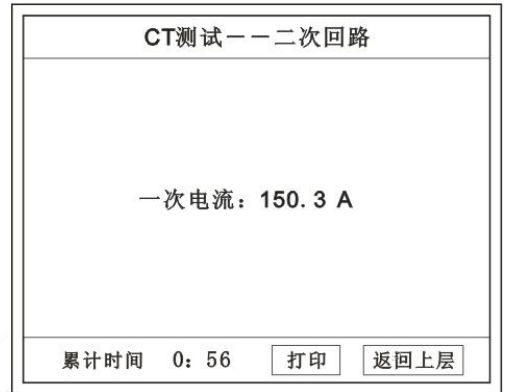

E.



4. PT

PT



PT

PT

CT


CT

A. PT



PT

PT



a.



0 - 3 A



0~330V



b.

B. PT

PT 变比测试	
自动试验	
一次输出电压 1000V	二次电压
返回上层	

a.



0 - 1000



5

b.

一次电压: 1000 V	
角差	1.83°
比差	0.00%
返回上层	

PT

a x

C.

5

1000V

PT测试——二次耐压

一次电压：1000 V
绝缘电流：0.001 V

累计时间 1: 00

5.

11/11/2019

CT

PT

A. CT

a.

b.

1

1

1

数据查询

请输入:

编号: ABC001

日期: 09年 5 月 1 日


确定

取消

[illegible]










6. U


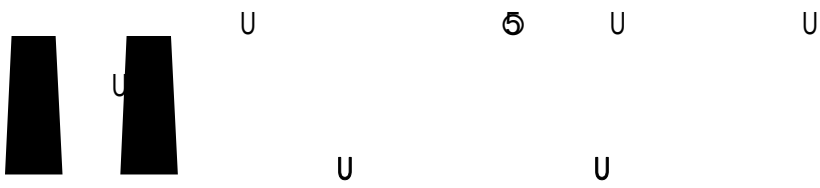


7.



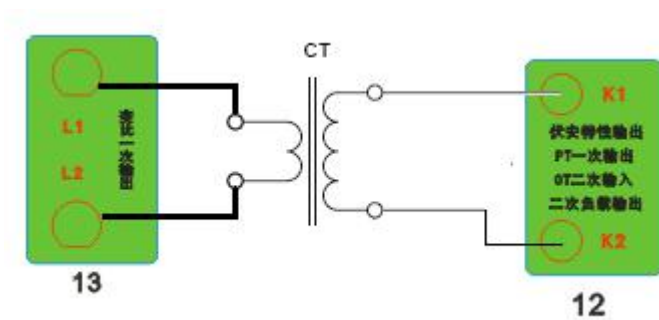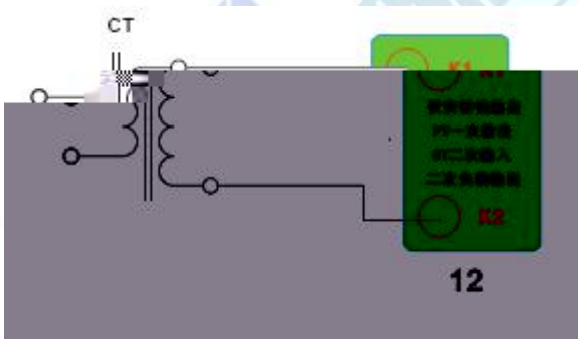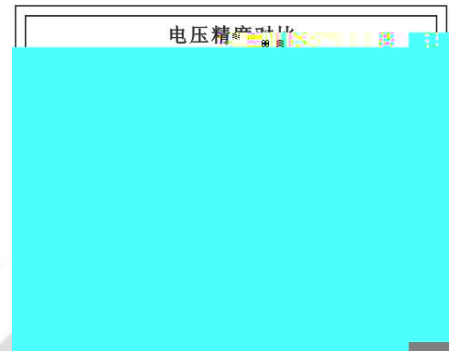

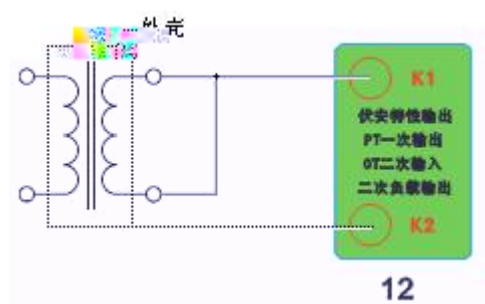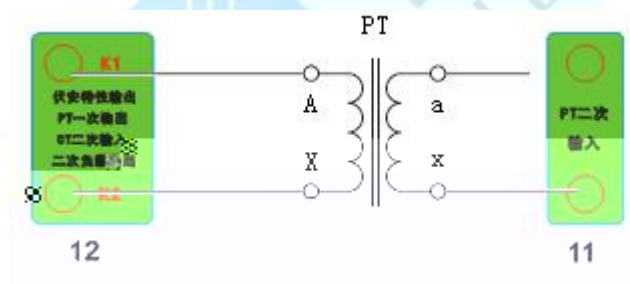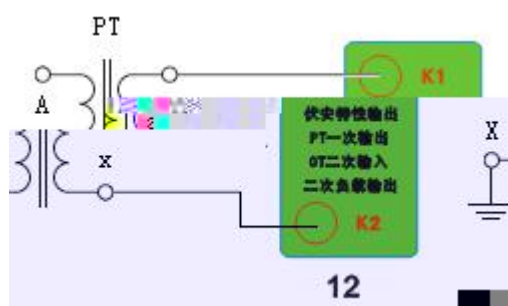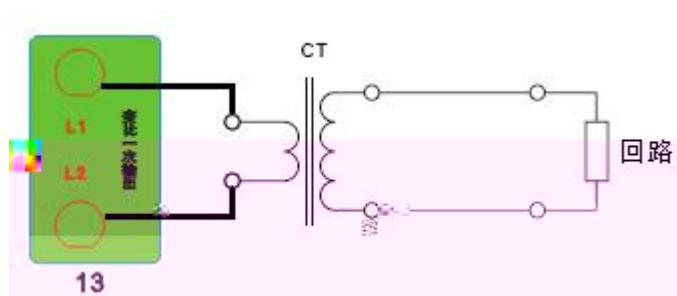

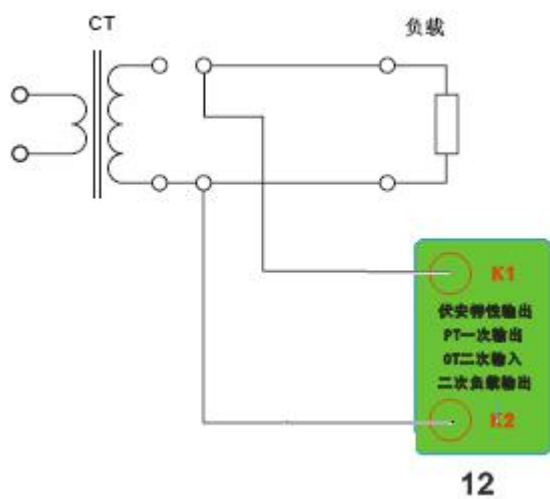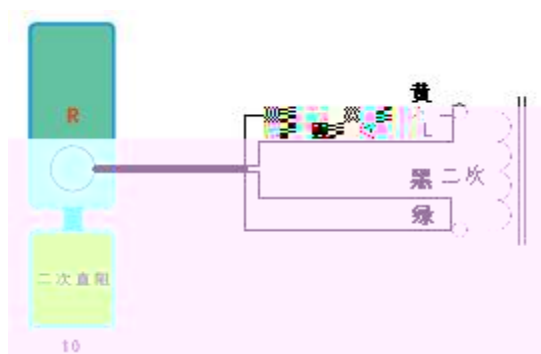

“

”

“

”

1

2

1.

2.

1

2

3

2

24

027-83267669

24

48

4