

HZJS-11

0 56-II

È

CXà' ÿ ×

X B+

f⁻+X\ × \ × ñ?ôl,í,

B'

B'F2f,í +e\$À× Ð"€

赫兹电力
HERTZ POWER




.....	1
.....	1
.....	1
.....	2
.....	3
.....	4
.....	8
.....	10
.....	11



	50Hz	45/55Hz
	180V ~ 270VAC	50Hz / 60Hz ± 1%
	0 40	≤ 90%RH
	50Hz	45/55Hz
	27.6	kg

∞

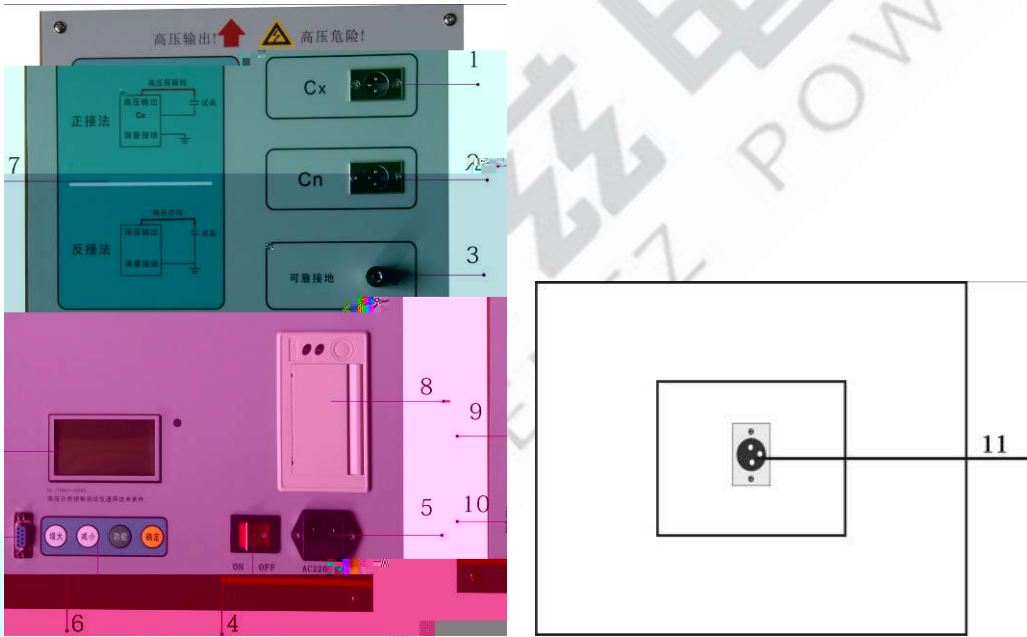

1 C_x

2 C_N

3

4.

5.

6.

7

220V ± 10% 50Hz


“ ” “ ” “ ” “ ”





0V

3

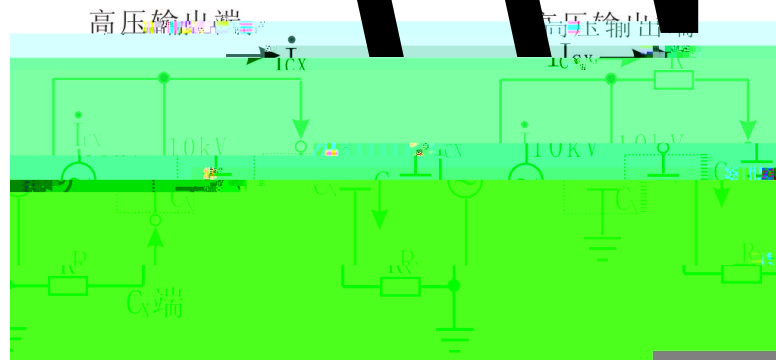

a

b

3

10kV

=

1

5

BR16

1

2


11

;

Cx

E

L

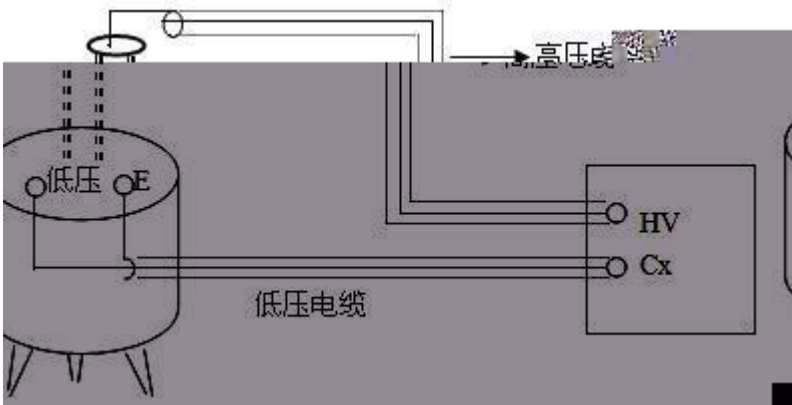

5

BR16

HVx

Cx

2


6

1

2

L

E

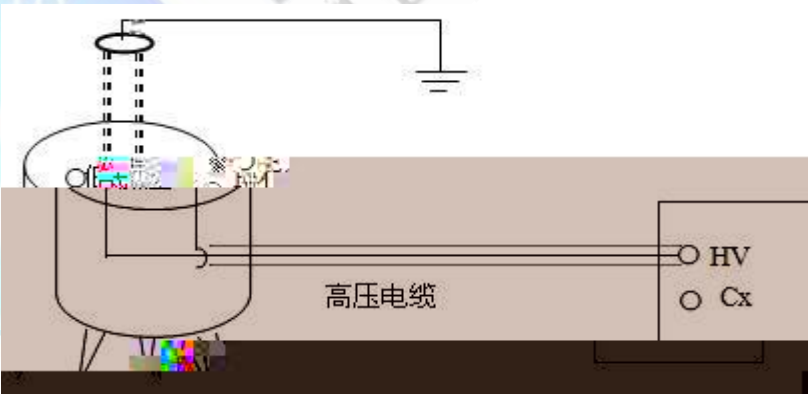

6

BR16

HV


10kV

HV

3


1

7

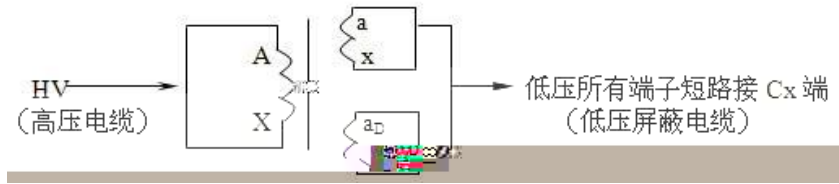


7

X	A	X	HV	Cx
	2	3kV	A	X
			8	10kV
2				AX

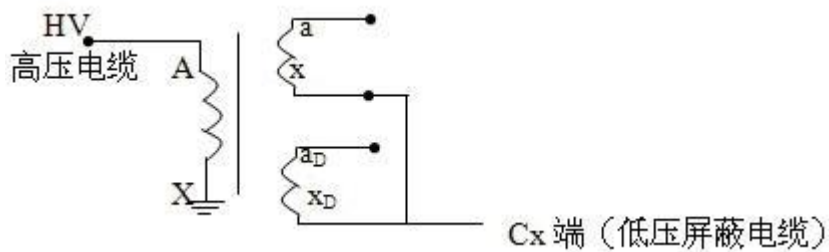

8

3	9	X	2.5	3kV
---	---	---	-----	-----

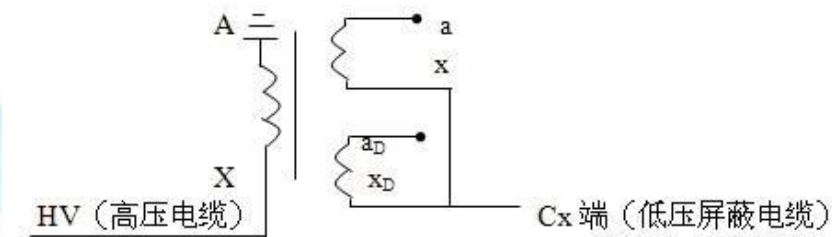

9

4				
1				HV
C _x				
2				
	HV	Cx		
5				
			A	B C 0

HV

HV

Cx



1				
2				
3				
4				
5				

6

10

Cx

7


1

2

tg δ

8

1

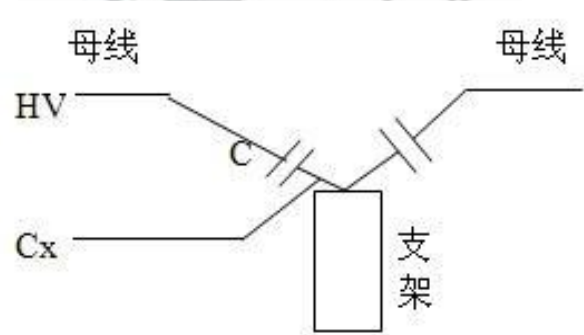

10




服务宗旨：快速响应，**客户满意，超过期望**

10kV

$$\Phi$$

027-81

w 163.com

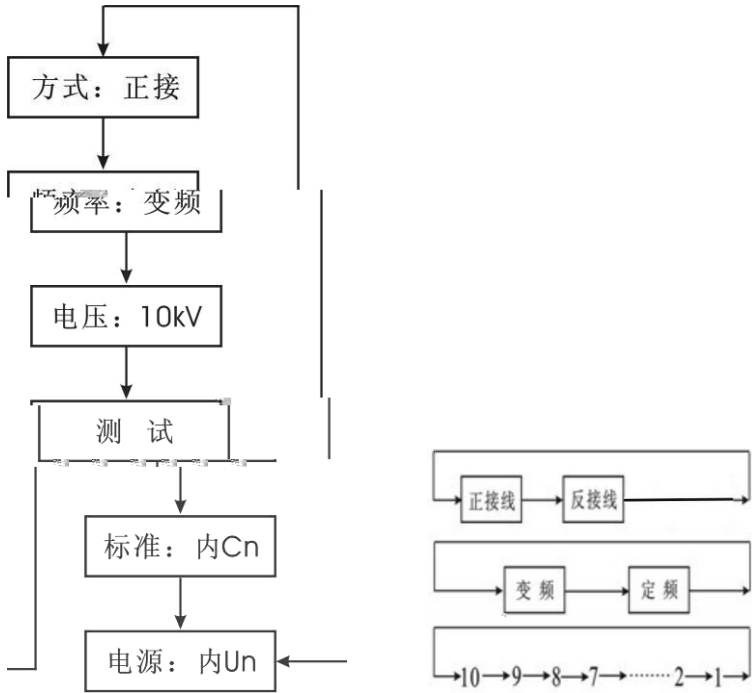

12

正接	内 Un
变频 10kV	内 Cn
Testing	55%

13

CX = 50.85PF
tg δ = 0.002%

4

5

14

15

tg δ

CX

V

I

F1 F2

14

15

tg δ

100%



∞

1

2

3

4

5

6

7

8

1

2

1

2

1

2

1

2

1

2

1

2

1

2

1

2

1

2

1

2

1

2

1

2

2

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

1

60-100cm

CX

$-\tan \delta$

$\tan \delta$

$-\tan \delta$

T

$-\tan \delta$

$-\tan \delta$

$-\tan \delta$

$\tan \delta$

90

$\tan \delta$

$\tan \delta$

20

$\tan \delta$

$\tan \delta$

2

100

20

20

$\tan \delta$

70

$\tan \delta$

$\tan \delta$

70 90

90

$\tan \delta$

90

$\tan \delta$



“

”

“

”

1

2

1.

2.



1

2

3

2

24

027-83267669

24

48

4