





HZCDP-30kV

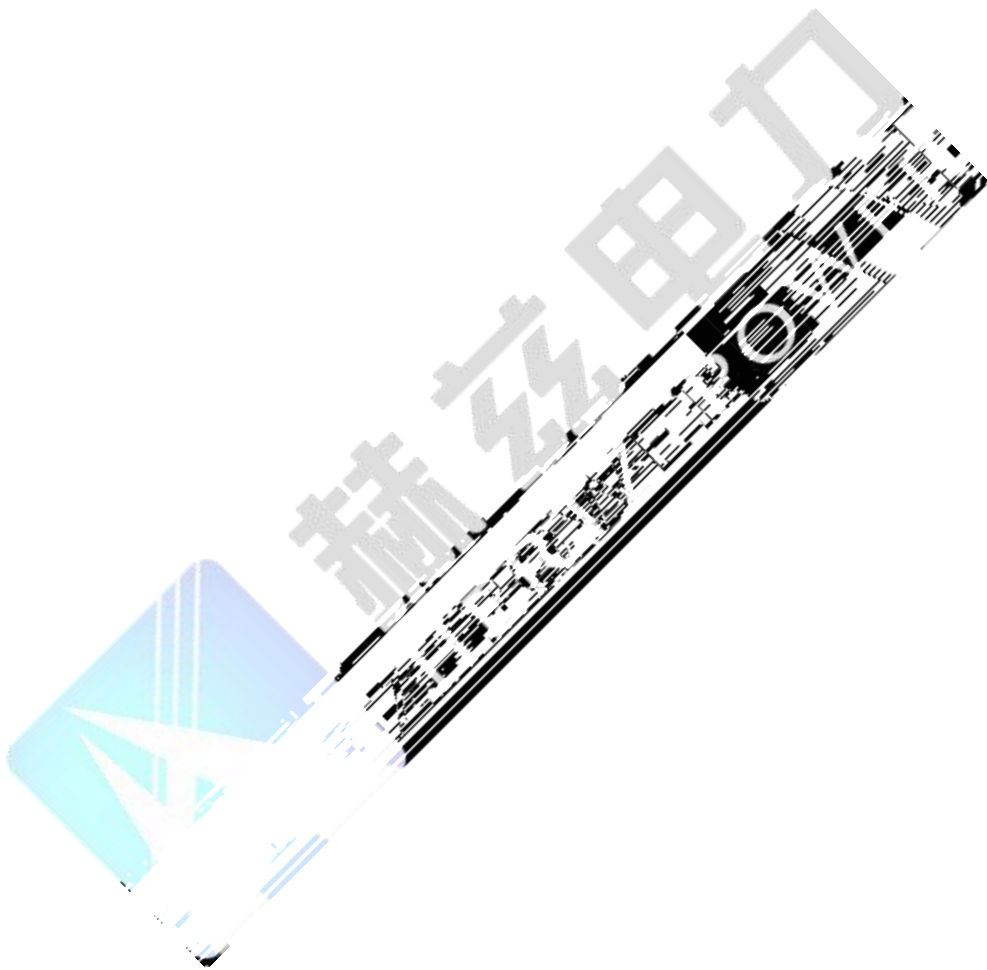

1.1

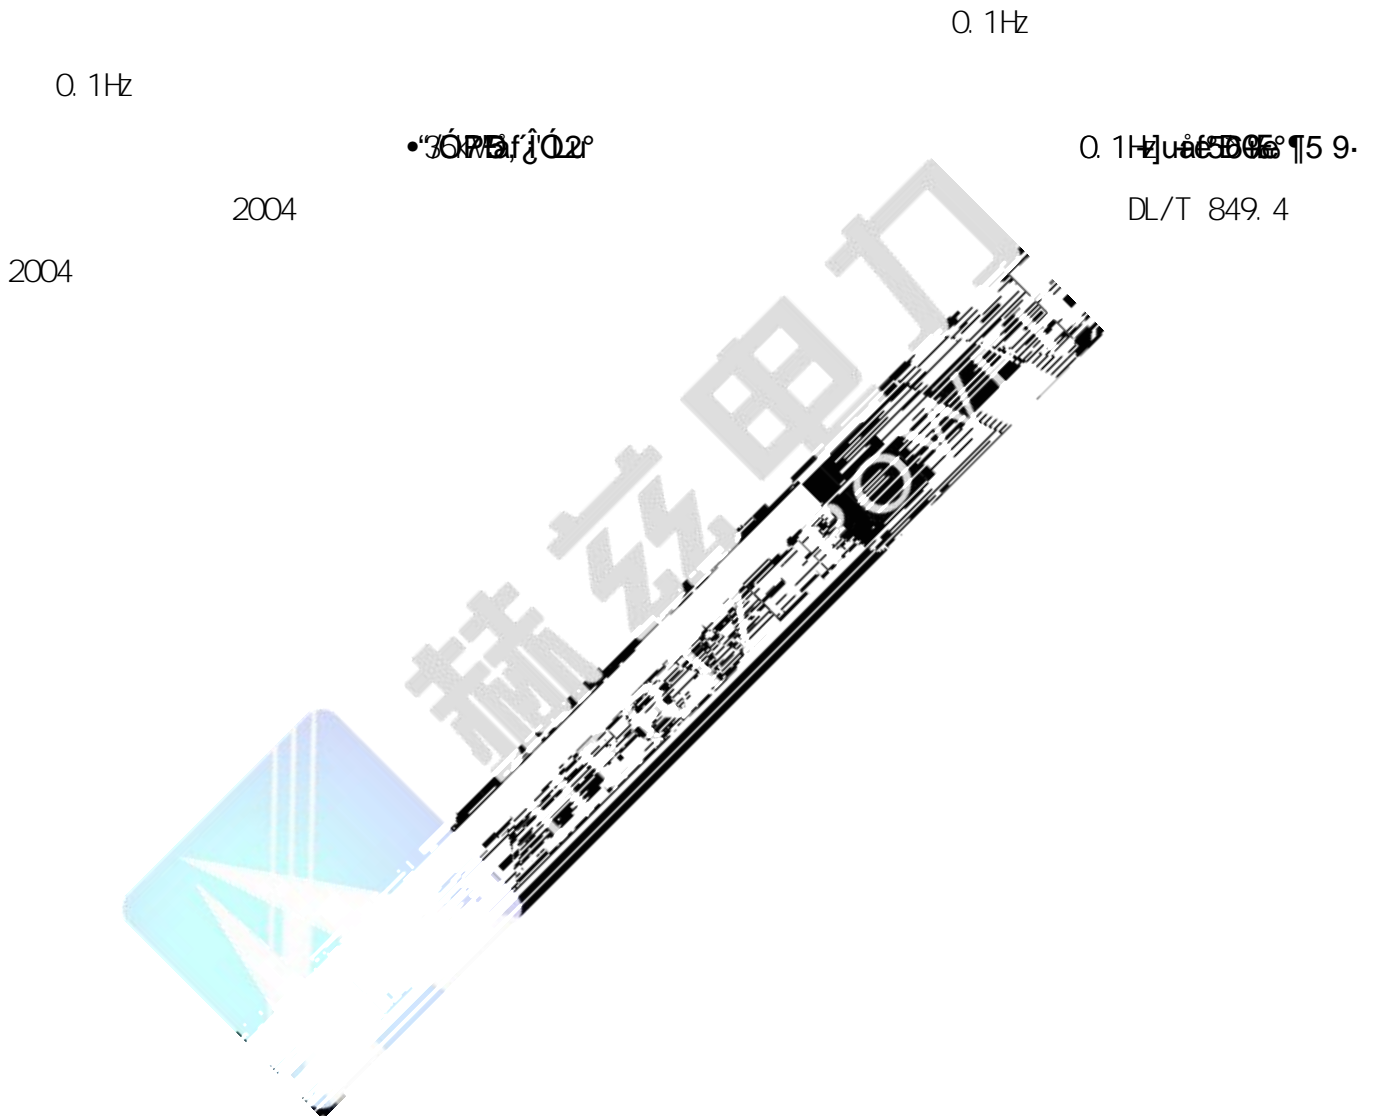

--	--	--	--	--	--	--

1 0.1Hz

2

1.2

1	DL/T 849.4-2004		4
2	Q/ED116501-2004		

1.3

1.

9.

10.

1.4

1. 220V± 5% 50± 2Hz

3kW

50Hz 220V± 5%

2. 30kV

3. 0.1Hz 0.05Hz 0.02Hz

4. 0.1Hz-1.1uF 0.05Hz-2.2uF 0.02Hz-5.5uF

4. 3%


5. 3

6. 5

7. -10 +40 85 RH

1.5

1.

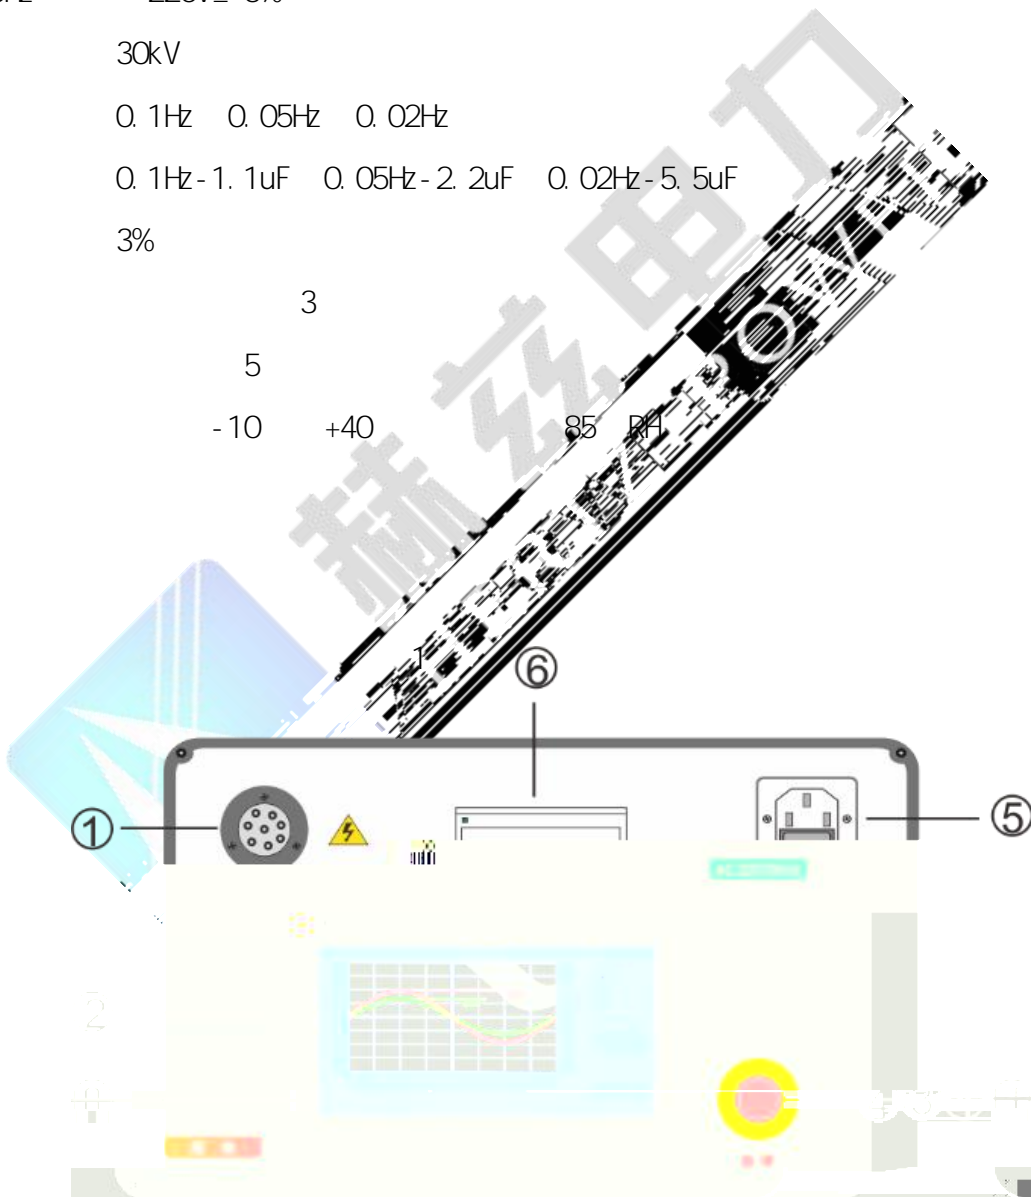

|

1

1 .

2 .

3 .


4 . /

5 . AC220V

6 .

2.

2

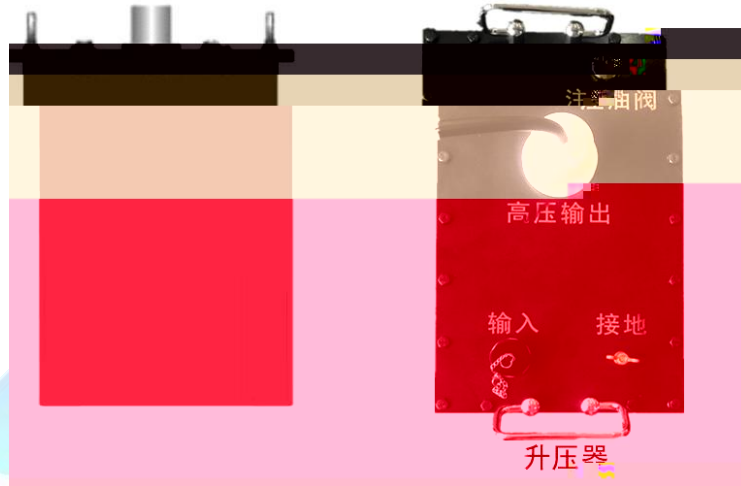

2

1 1.

2


3

4

2.1

AC220V

3

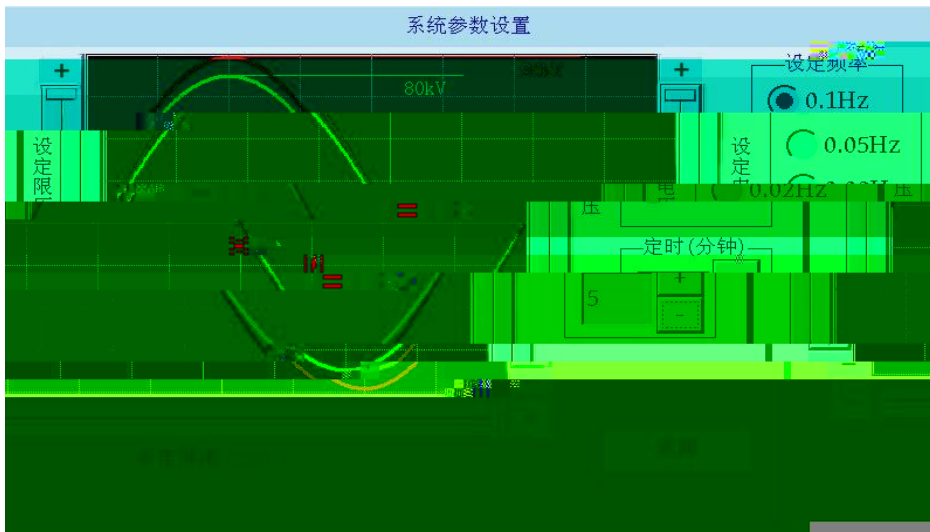


- | | | | | |
|----|-------|---------------------|------|------|
| 1. | " | " | " +" | " -" |
| | / 1kV | " | " +" | " -" |
| 2. | " | " | " +" | " -" |
| | / 1kV | " | " +" | " -" |
| 3. | " | " | " +" | " -" |
| | / 1mA | " | " +" | " -" |
| 3. | 3 | 0.1Hz 0.05Hz 0.02Hz | | |
| 4. | | 99 | " +" | " -" |
| | " | " | | |

2.2

" "

4

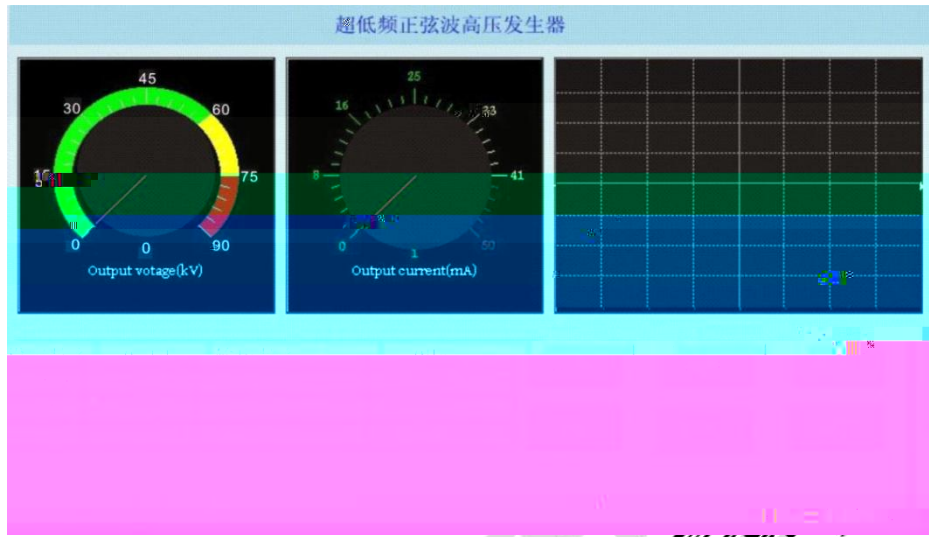

2.3

" "

5

" "

64

64

电压 (kV)	电流 (mA)	频率 (Hz)	时长	时间
25	12	0.1	00:20:53	2010/02/19 14:23:48


5


3.2

3.2.1

" "

" "

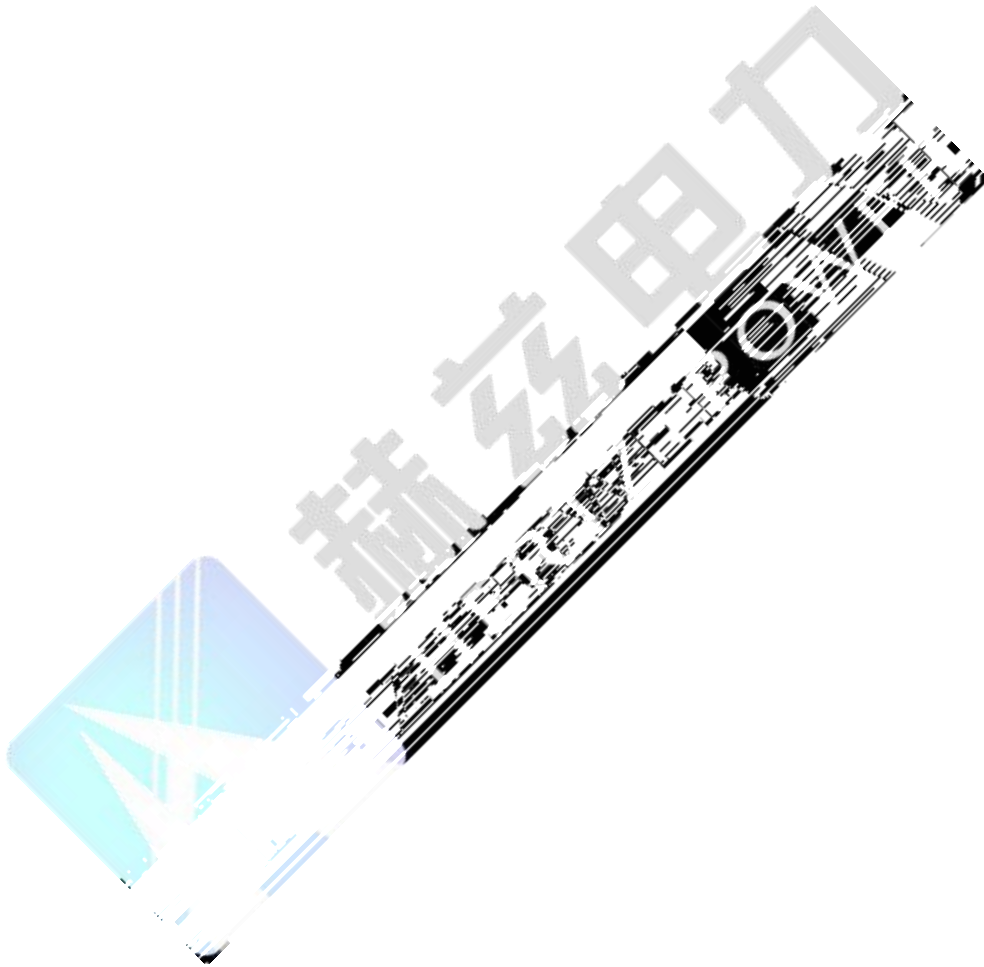


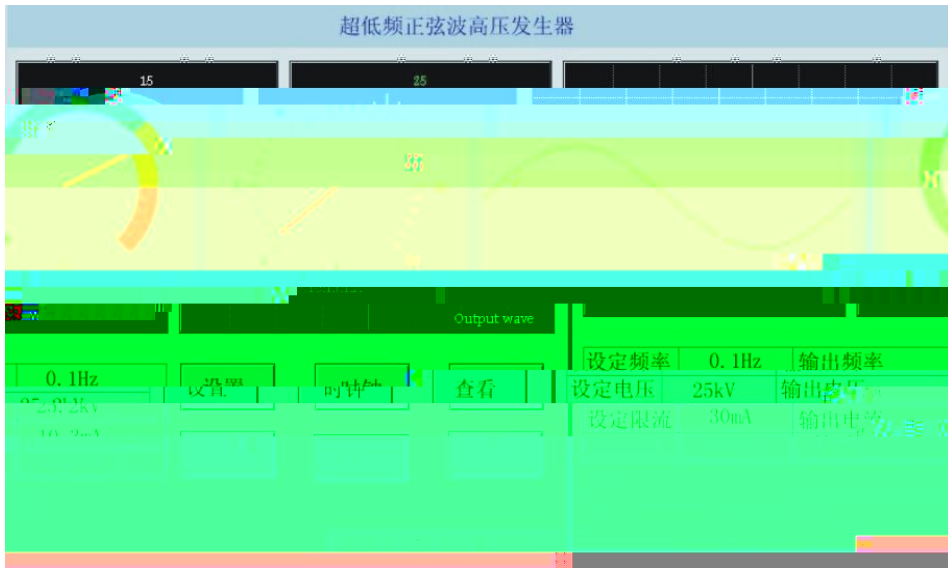


10

3.2.4

"

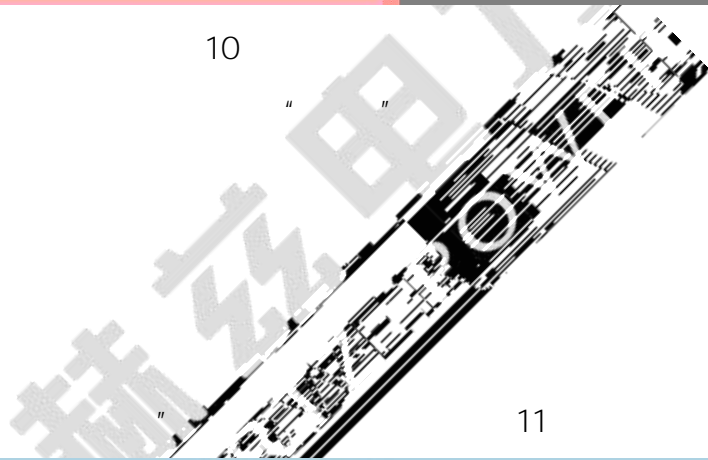

11

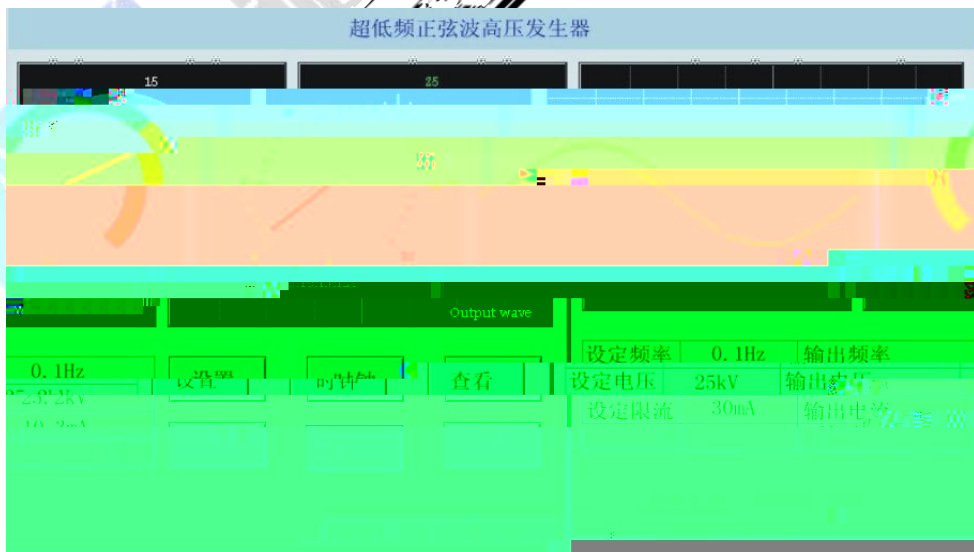


11

3.2.4

12 13

225

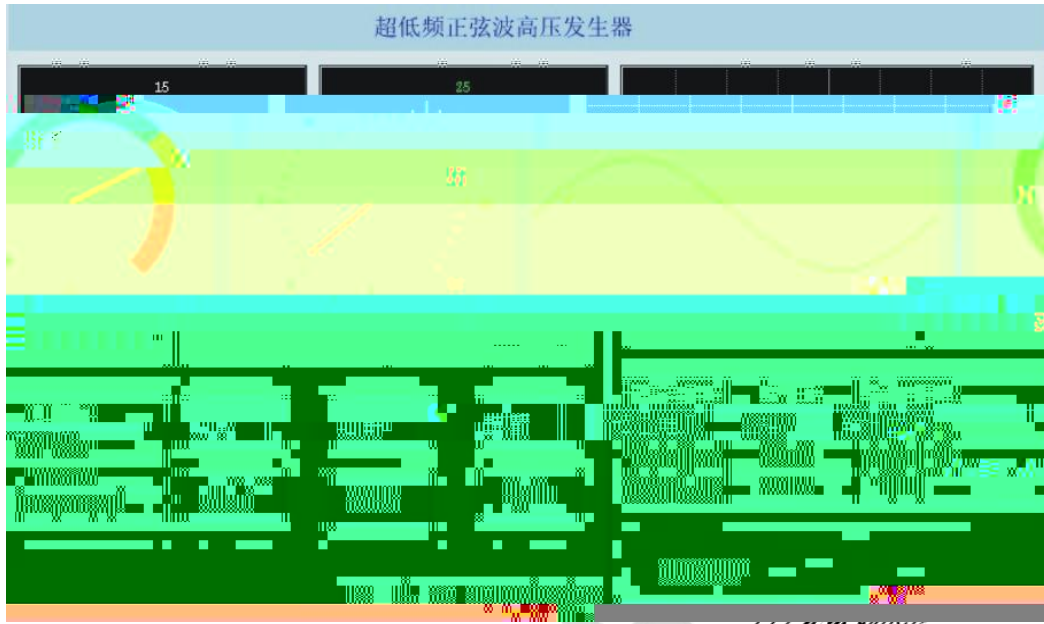

12



13

4.1

1.

2.

3.

1

$U_{max}=3U_0$

U_0

10kV


$U_0=6kV$

$U_{max}=3U_0=18kV$

0.1Hz



额定电压		交接试验				预防性试验	
$3U_0$	5	60	$3U_0$	5	15	1.8/3	
$3U_0$	11	60	$3U_0$	11	15	3.6/6	
$3U_0$	18	60	$3U_0$	18	15	6/6	
$3U_0$	18	60	$3U_0$	18	15	6/10	
$3U_0$	26	60	$3U_0$	26	15	8.7/10	

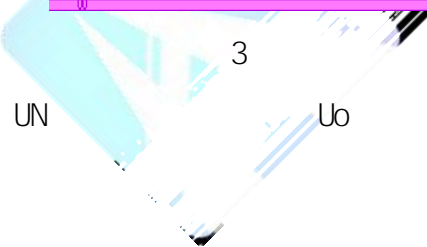

0.1Hz

UN

U_0

0.05μ F

4.

5.

6.

60


15

$I_0=2 fCU=2 \times 3.14 \times 0.1CU(mA) \dots\dots\dots (1)$

C

μF U

kV

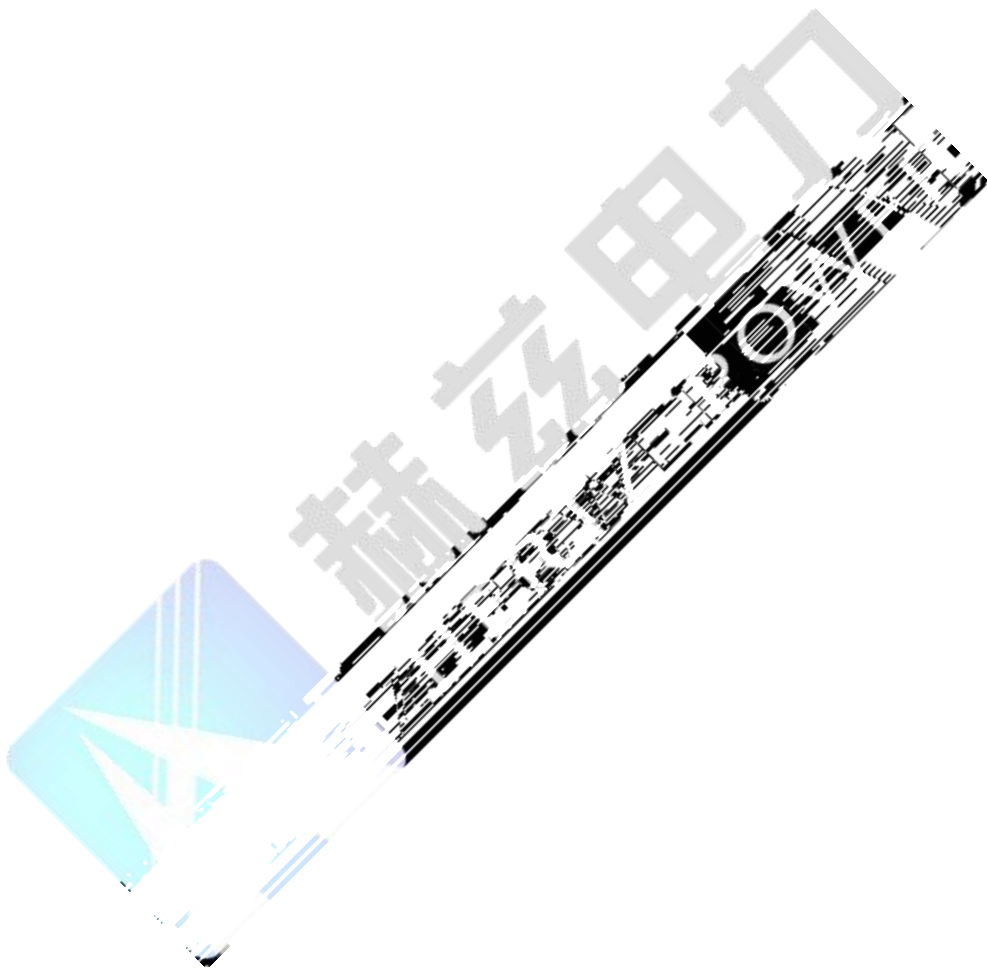



10.


4.2

1

0.1Hz

2

15

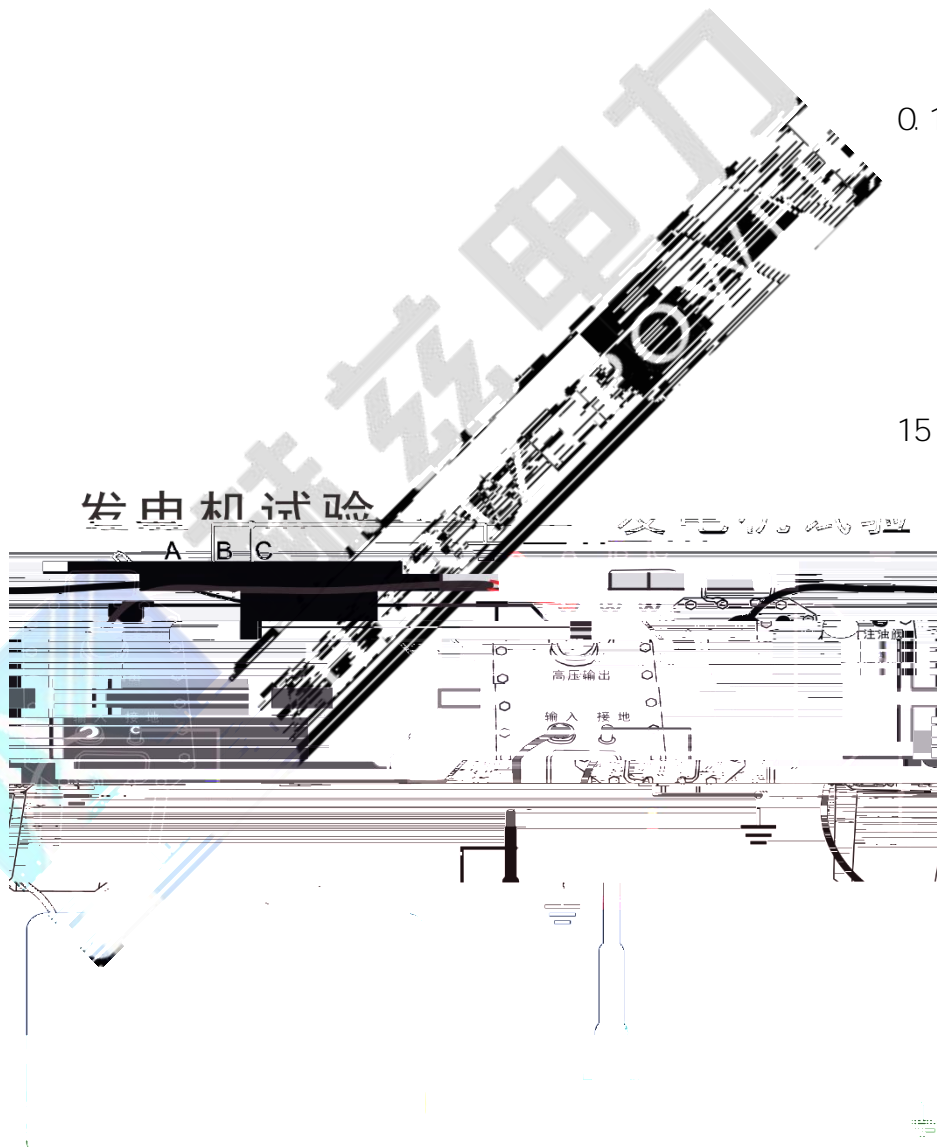

15

0 1.3 1.5
13.8 kv

max X 50-19

1.2x 1.5x 13.8 35.1(kV)

4


5

j

	汽轮发电机			水轮发电机			
发电机容量 (MW)	300	300	600	45	125-150	300	400
单相对地电容	0.184	0.35-0.25	0.31-0.34	0.35	0.35	0.35	0.35



升压器

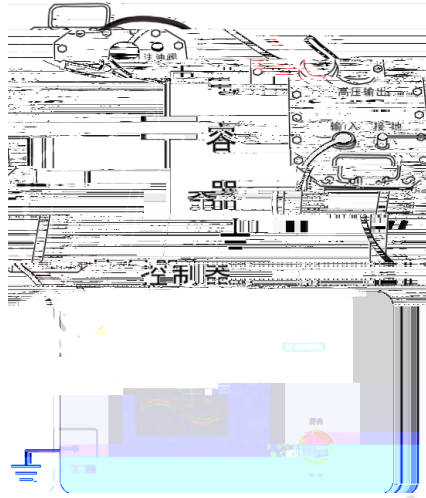

16

4. 4


17

六升压器

17

225


- 1.
- 2.
- 3.

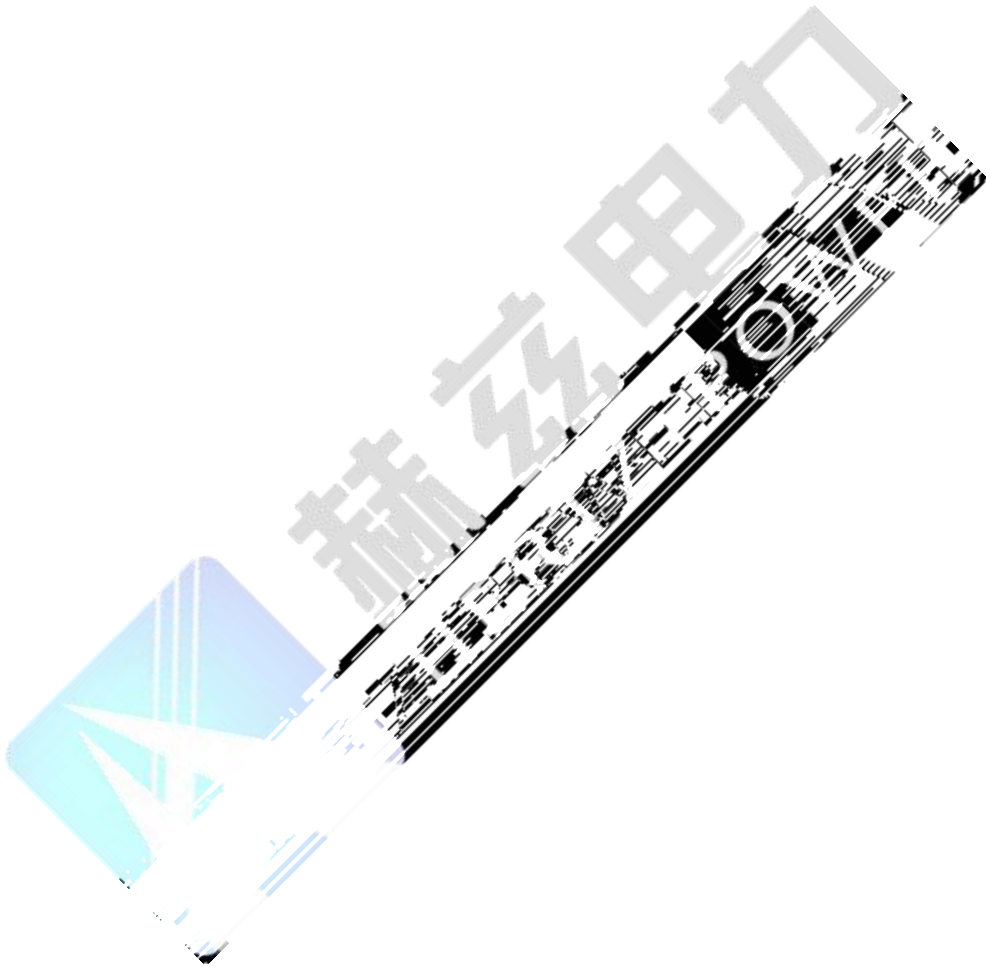



1		1	
2		1	
3		2	
4		1	
5		1	
6			
7			
8		1	
9		3	
10		2	
11		1	
12		1	
13		1	

c " e

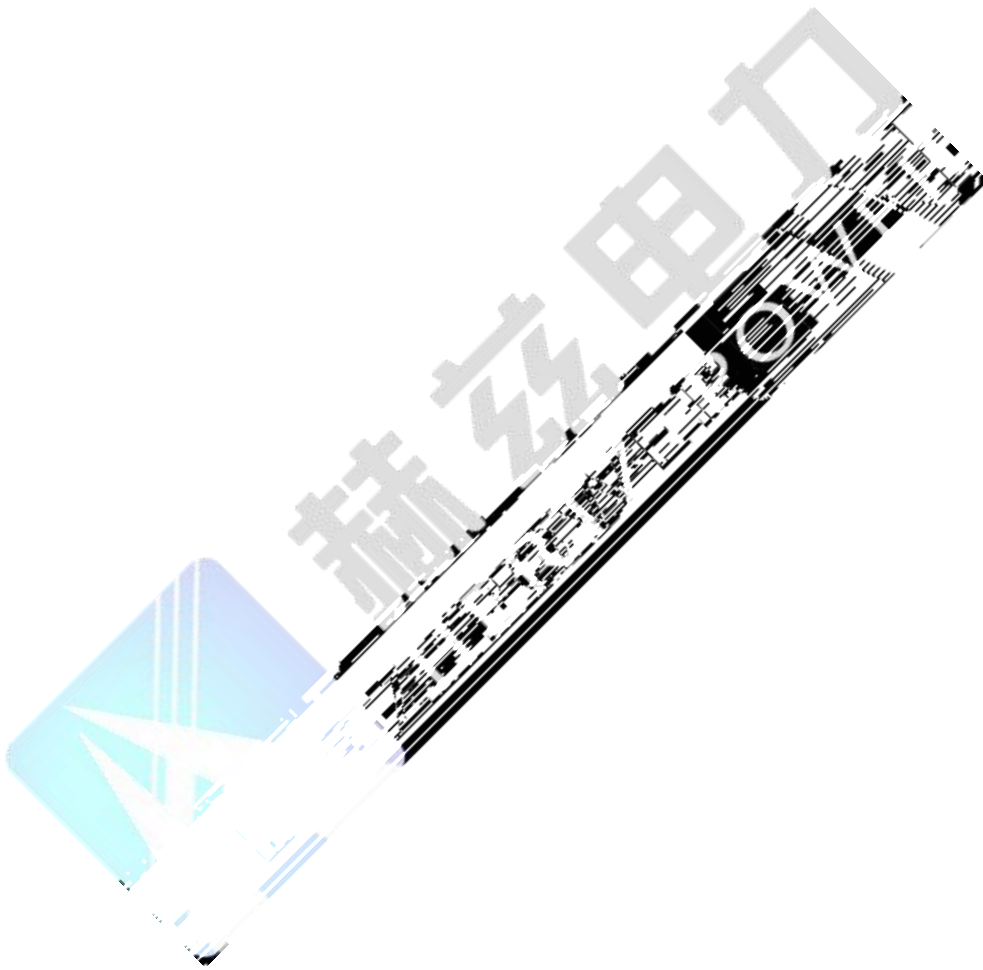

产品宗旨：技术领先，质量可靠，轻便易用

服务宗旨：快速响应，问题到满意，超过期

